

REPORT

FOR: Badger Cork

ON: Badger Cork 6 mm AcoustiCORK®
Underlayment With A Floating Floor
On 6" Precast Concrete Slabs
With Suspended 5/8" Gypsum Ceiling

Sound Transmission Loss
Test RAL™-TL95-364

Page 1 of 3

Revision 17 February 1998

CONDUCTED: 14 November 1995

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E90-90 and E413-87, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The microphone used was a Bruel & Kjaer serial number 1440522.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the client as a Badger Cork 6 mm AcoustiCORK underlayment with a floating floor on 6" precast concrete slabs with suspended 5/8" gypsum ceiling. The overall dimensions of the specimen were nominally 4.27 m (168 in.) wide by 6.10 m (240 in.) long and 416 mm (16.38 in.) thick. The specimen was constructed directly in the laboratory's 4.27 m (14 ft) by 6.10 m (20 ft) test opening and was sealed on the periphery (both sides) with a dense mastic. The description of the specimen was as follows: From the top down, the floor consisted of a 14 mm (0.5625 in.) thick floating wood floor, manufactured by Universal Flooring Limited, set on Badger Cork 6 mm (0.236 in.) thick, AcoustiCORK underlayment. The 6 mm AcoustiCORK was set on a 6 mil plastic vapor barrier which was laid directly on the concrete slab sub-floor. The sub-floor consisted of ten nominally 610 mm (24 in.) wide by 4.23 m (166.5 in.) by 152 mm (6 in.) thick wire reinforced concrete slabs. Split drive pins were inserted into the bottom of the slabs on 1.22 m (48 in.) centers and used to tie 12 gauge hanger wire for the suspended ceiling. The hanger wires were tied to allow for a nominal 229 mm (9 in.) plenum depth from the bottom of the slabs to the top of the ceiling. Cold rolled steel carrying channels were tied to the hanger wires and twelve 24 gauge galvanized steel DWC channels (hat channels) were saddle tied perpendicular to the cold rolled channels with double strands of 24 gauge tie wire. A layer of 16 mm (0.625 in.) thick Type X wallboard was attached to the DWC channels. The joints between the wallboard sheets were taped and covered with joint compound. The plenum between the sub-floor and the ceiling contained a single layer of 89 mm (3.5 in.) thick, R-11 unfaced fiberglass insulation. The weight of the entire specimen as determined was 5,775 kg (12,731.5 lbs) an average of 222.1 kg/m² (45.5 lbs/ft²). The transmission area used in the calculations was 26 m² (280 ft²). The source and receiving room temperatures at the time of the test were 22°C (72±2°F) and 61±2% relative humidity.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

REPORT

Badger Cork

RAL™-TL95-364

14 November 1995

Page 2 of 3

Revision 17 February 1998

TEST RESULTS

Sound transmission loss values are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the TL test data are within the limits set by the ASTM Standard E90-90.

<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>	<u>FREQ.</u>	<u>T.L.</u>	<u>C.L.</u>	<u>DEF.</u>
100	29	0.20	0	800	66	0.28	0
125	39	0.08	5	1000	70	0.30	0
160	44	0.13	3	1250	75	0.26	0
200	44	0.22	6	1600	78	0.22	0
250	48	0.22	5	2000	80	0.19	0
315	51	0.25	5	2500	80	0.16	0
400	54	0.28	5	3150	86	0.10	0
500	57	0.26	3	4000	89	0.11	0
630	62	0.29	0	5000	90 *	0.08	0

STC = 60

ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)

T.L. = TRANSMISSION LOSS, dB

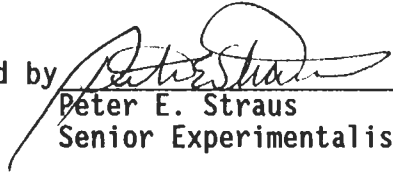
C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT

DEF. = DEFICIENCIES, dB<STC CONTOUR

STC = SOUND TRANSMISSION CLASS

* = INDICATES A CORRECTION WAS APPLIED TO THE DATA DUE TO BACKGROUND NOISE LEVELS IN THE RECEIVING ROOM

Submitted by


 Peter E. Straus
 Senior Experimentalist

Reviewed by


 John W. Kopec
 Laboratory Manager

Revision 17 February 1998

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
 ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
 THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
 OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.