

REPORT

FOR: Badger Cork

Impact Sound Transmission
Test RAL™-IN95-37ON: Badger Cork 6 mm AcoustiCORK®
Underlayment With Ceramic Tile On A
6" Precast Concrete Slab Floor
With Suspended 5/8" Gypsum CeilingPage 1 of 3

Revision 17 February 1998

CONDUCTED: 23 August 1995

TEST METHOD

Unless otherwise designated, the measurements reported below were made with all facilities and procedures in explicit conformity with the ASTM Designations E492-90 and E989-89, as well as other pertinent standards. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure. A description of the measuring technique is available separately. The serial number of the measuring microphone was 1330658.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the client as a Badger Cork 6 mm AcoustiCORK underlayment with ceramic tile on a 6" precast concrete slab floor with suspended 5/8" gypsum ceiling. The overall dimensions of the specimen were nominally 4.27 m (168 in.) wide by 6.10 m (240 in.) long and 422 mm (16.625 in.) thick. The specimen was constructed directly in the laboratory's 4.27 m (14 ft) by 6.10 m (20 ft) test opening and was sealed on the periphery (both sides) with a dense mastic. The description of the specimen was as follows: From the top down, the floor consisted of standard grade 152 mm (6 in.) by 152 mm (6 in.) by 6.4 mm (0.25 in.) thick glazed ceramic tile set on Badger Cork 6 mm (0.236 in.) thick, AcoustiCORK underlayment. The 6 mm AcoustiCORK was set on a layer of 15 lb. roofing felt which was laid directly on the concrete slab sub-floor. The sub-floor consisted of ten nominally 610 mm (24 in.) wide by 4.23 m (166.5 in.) by 152 mm (6 in.) thick wire reinforced concrete slabs. Split drive pins were inserted into the bottom of the slabs on 1.22 m (48 in.) centers and used to tie 12 gauge hanger wire for the suspended ceiling. The hanger wires were tied to allow for a nominal 229 mm (9 in.) plenum depth from the bottom of the slabs to the top of the ceiling. Cold rolled steel carrying channels were tied to the hanger wires and twelve 24 gauge galvanized steel DWC channels (hat channels) were saddle tied perpendicular to the cold rolled channels with double strands of 24 gauge tie wire. A layer of 16 mm (0.625 in.) thick Type X wallboard was attached to the DWC channels. The joints between the wallboard sheets were taped and covered with joint compound. The plenum between the sub-floor and the ceiling contained a single layer of 89 mm (3.5 in.) thick, R-11 unfaced fiberglass insulation. The weight of the entire specimen as determined was 6,281.5 kg (13,848 lbs) an average of 241.6 kg/m² (49.5 lbs/ft²). The source and receiving room temperatures at the time of the test were 23°C (74±2°F) and 64±2% relative humidity.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

REPORT

Badger Cork

RAL™-IN95-37

23 August 1995

Page 2 of 3

Revision 17 February 1998

TEST RESULTS

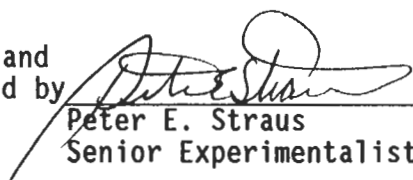
Sound pressure levels at 1/3 octave intervals, normalized to 10 square meters, are given in tabular form. The impact insulation class, IIC, was computed in accordance with ASTM E989-89 and ASTM E492-90.

<u>FREQ.</u>	<u>ISL</u>	<u>C.L.</u>	<u>DEV.</u>	<u>FREQ.</u>	<u>ISL</u>	<u>C.L.</u>	<u>DEV.</u>
100	59	0.43	8	630	42	0.24	0
125	52	0.60	1	800	37	0.25	0
160	51	0.35	0	1000	32	0.24	0
200	56	0.36	5	1250	25	0.22	0
250	52	0.21	1	1600	19	0.27	0
315	50	0.21	0	2000	17	0.26	0
400	50	0.22	0	2500	17	0.33	0
500	46	0.40	0	3150	14	0.32	0

IIC = 61

ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)
 ISL = IMPACT SOUND PRESSURE LEVEL, dB
 C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT
 DEV. = DEVIATION
 IIC = IMPACT INSULATION CLASS

Tested and
Reviewed by

 Peter E. Straus
 Senior Experimentalist

Submitted by


 John W. Kopec
 Laboratory Manager

Revision 17 February 1998

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.



ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY
 ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.
 THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES
 OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.